

HG. 2

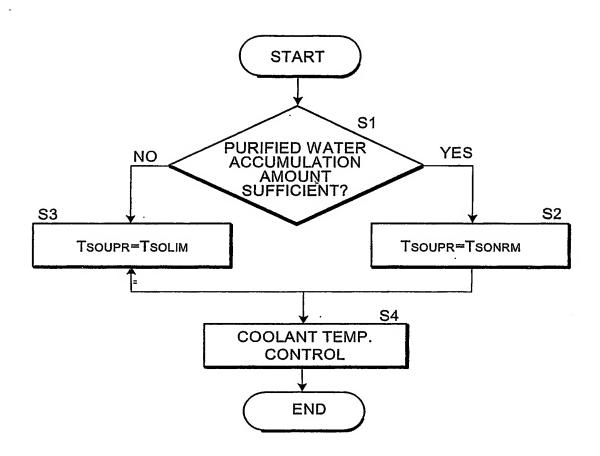


FIG. 3

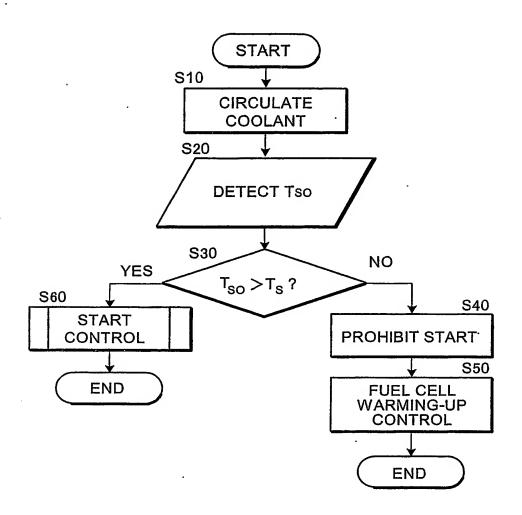
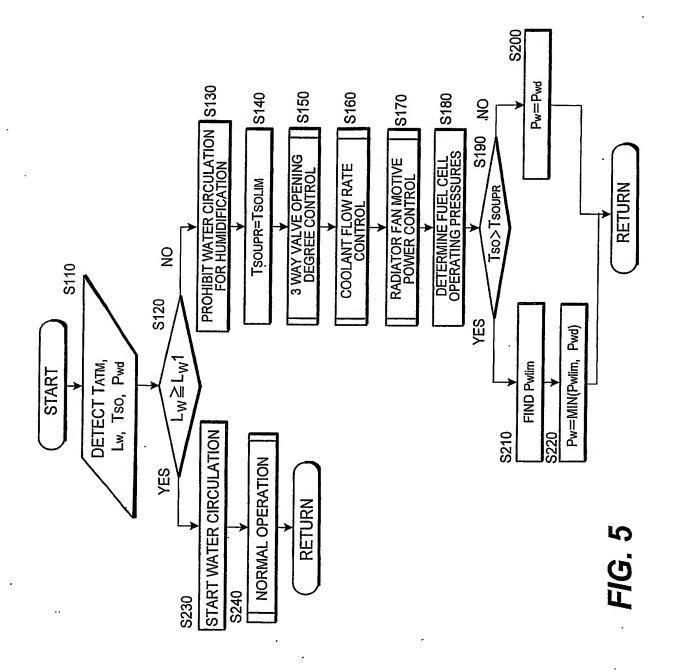


FIG. 4

5/22



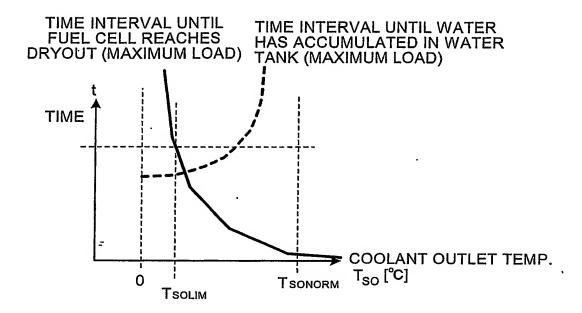


FIG. 6




FIG. 7

SPLIT FLOW RATIO Rvo [%] TO COOLING LOOP

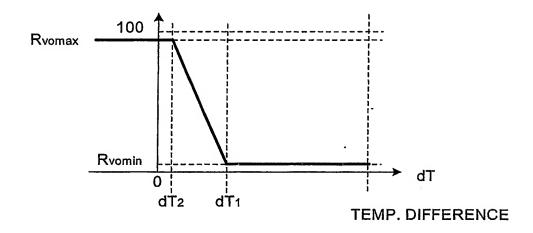


FIG. 8

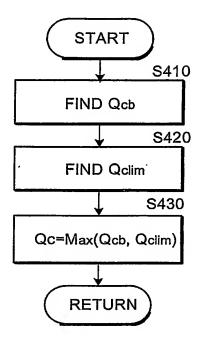


FIG. 9

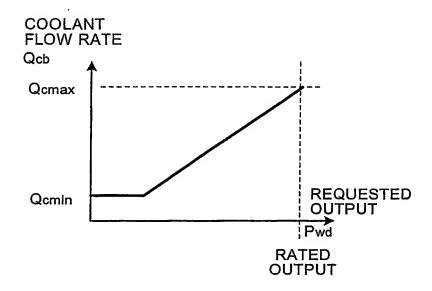


FIG. 10

COOLANT FLOW RATE MINIMUM LIMIT VALUE Qclim[l/min]

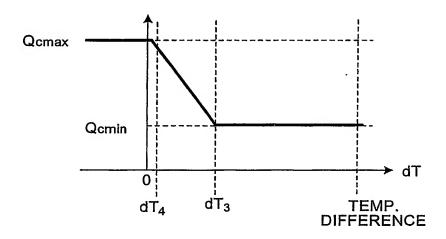


FIG. 11




FIG. 12

RADIATOR FAN MOTIVE POWER [W]

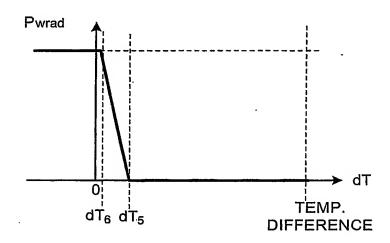


FIG. 13

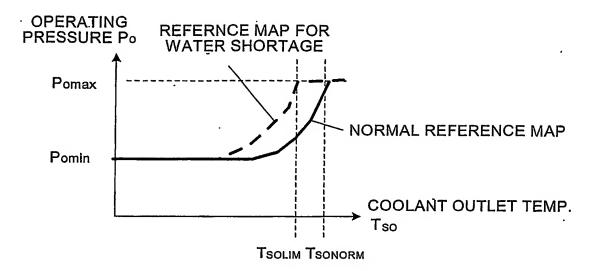


FIG. 14

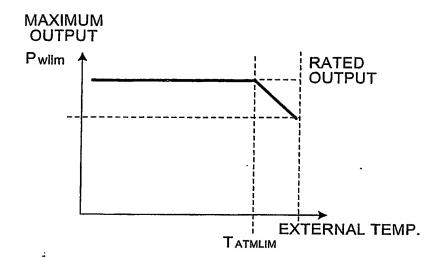


FIG. 15



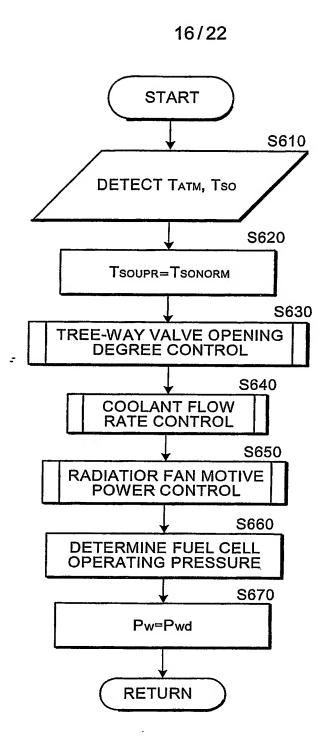


FIG. 16

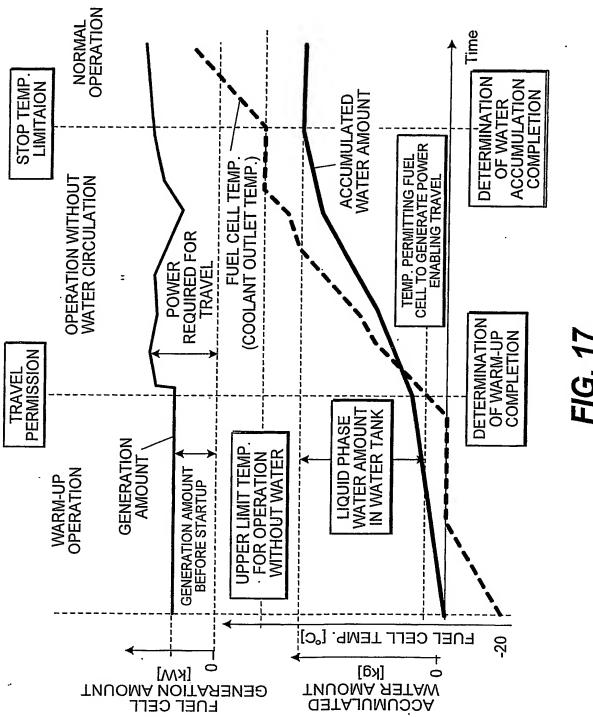

18/22

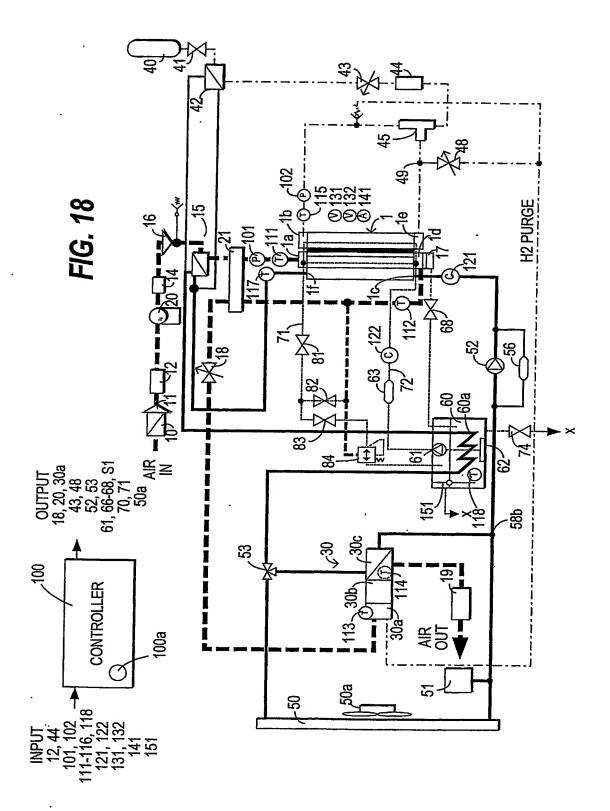

PCT/JP2003/015325

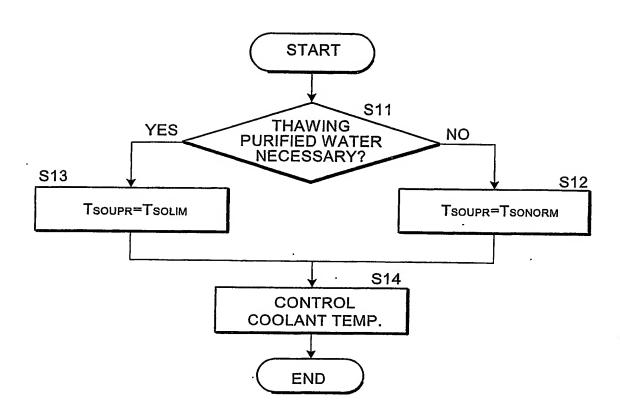
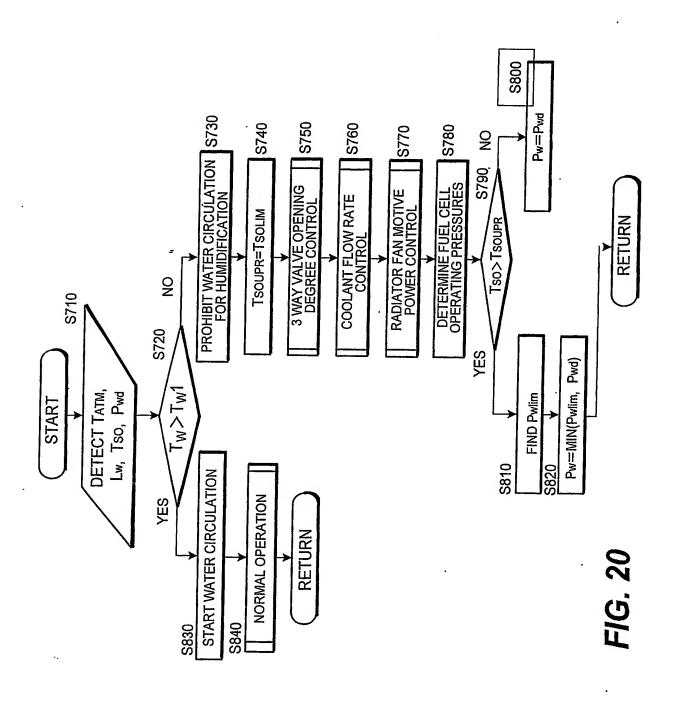


FIG. 19

20/22



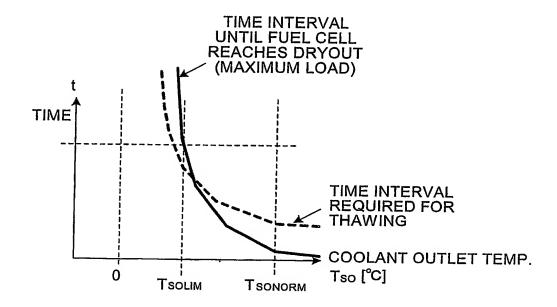


FIG. 21

